

1  
2  
3  
4  
5  
6  
7  
8  
9  
10  
11  
12  
13  
14  
15  
16  
17  
18  
19  
20  
21  
22  
23  
24  
25  
26  
27

CALIFORNIA  
STATE WATER RESOURCES CONTROL BOARD  
DIVISION OF DRINKING WATER

TO: HIDDEN VALLEY LAKE COMMUNITY SERVICES DISTRICT  
Attn: ROLAND SANFORD, GENERAL MANAGER  
19400 HARTMANN ROAD  
HIDDEN VALLEY LAKE, CA 95467-8371

AMENDMENT No. 1 TO COMPLIANCE ORDER NO. 02\_03\_14R\_004  
DATED February 27, 2015

The State Water Resources Control Board (hereinafter "Board"), acting by and through its Division of Drinking Water (hereinafter "Division") and the Deputy Director for the Division (hereinafter "Deputy Director"), hereby issues this Amendment No. 1 to Compliance Order 02\_03\_14R\_004 (hereinafter "Amendment No. 1).

The Board issued Compliance Order 02\_03\_14R\_004 (hereinafter "Order") to Hidden Valley Lake Community Services District (hereinafter "System") on or about October 17, 2014. This order was issued as a result of the Board's Division of Water Rights issuing, on May 27 and 29, 2014, curtailment notices to certain

1  
2  
3  
4  
5  
6  
7  
8  
9  
10  
11  
12  
13  
14  
15  
16  
17  
18  
19  
20  
21  
22  
23  
24  
25  
26  
27

junior water right holders in the Sacramento River and San Joaquin River watersheds. By means of the curtailment notice, the System was notified "of the need to immediately stop diverting under [the System's] post-1914 water rights...."

The System submitted documentation to the Board on February 10, 2015 demonstrating that the lots which are contained within Units 4 and 5 of the its service area have riparian water rights to Putah Creek. Based on the documentation submitted, the Board has made the determination that the System has a reliable source of supply for Units 4 and 5 that is not subject to the curtailment notice issued to the System.

The Board hereby amends the Order as follows:

A) The System is further directed as follows:

**DIRECTIVES**

A-1 Notwithstanding Directives 1 and 3, the System may make new service connections in Units 4 and 5 so long as the source of supply for said new connections is from the water source to which the lot has a riparian right.

A-2 Within 30 days after a new service connection is physically constructed in Unit 4 or Unit 5, the System shall submit to the Division the following information: the date the connection was installed, the street address and parcel number of the lot at which the service connection was installed, and a map of the unit in which the new service connection is located that identifies the location of the lot at which it was installed.

Amendment No. 1 to Compliance Order No.02\_03\_14R\_004

1  
2  
3  
4  
5  
6  
7  
8  
9  
10  
11  
12  
13  
14  
15  
16  
17  
18  
19  
20  
21  
22  
23  
24  
25  
26  
27

Except as amended herein, all other terms of Compliance Order No.  
02\_03\_14R\_004, remain in full force and effect.




Bruce H. Burton, P.E.,  
Assistant Deputy Director  
Northern California Field Operations Branch  
State Water Resources Control Board  
Division of Drinking Water

February 27, 2015  
Date



CERTIFIED MAIL #: \_\_\_\_\_

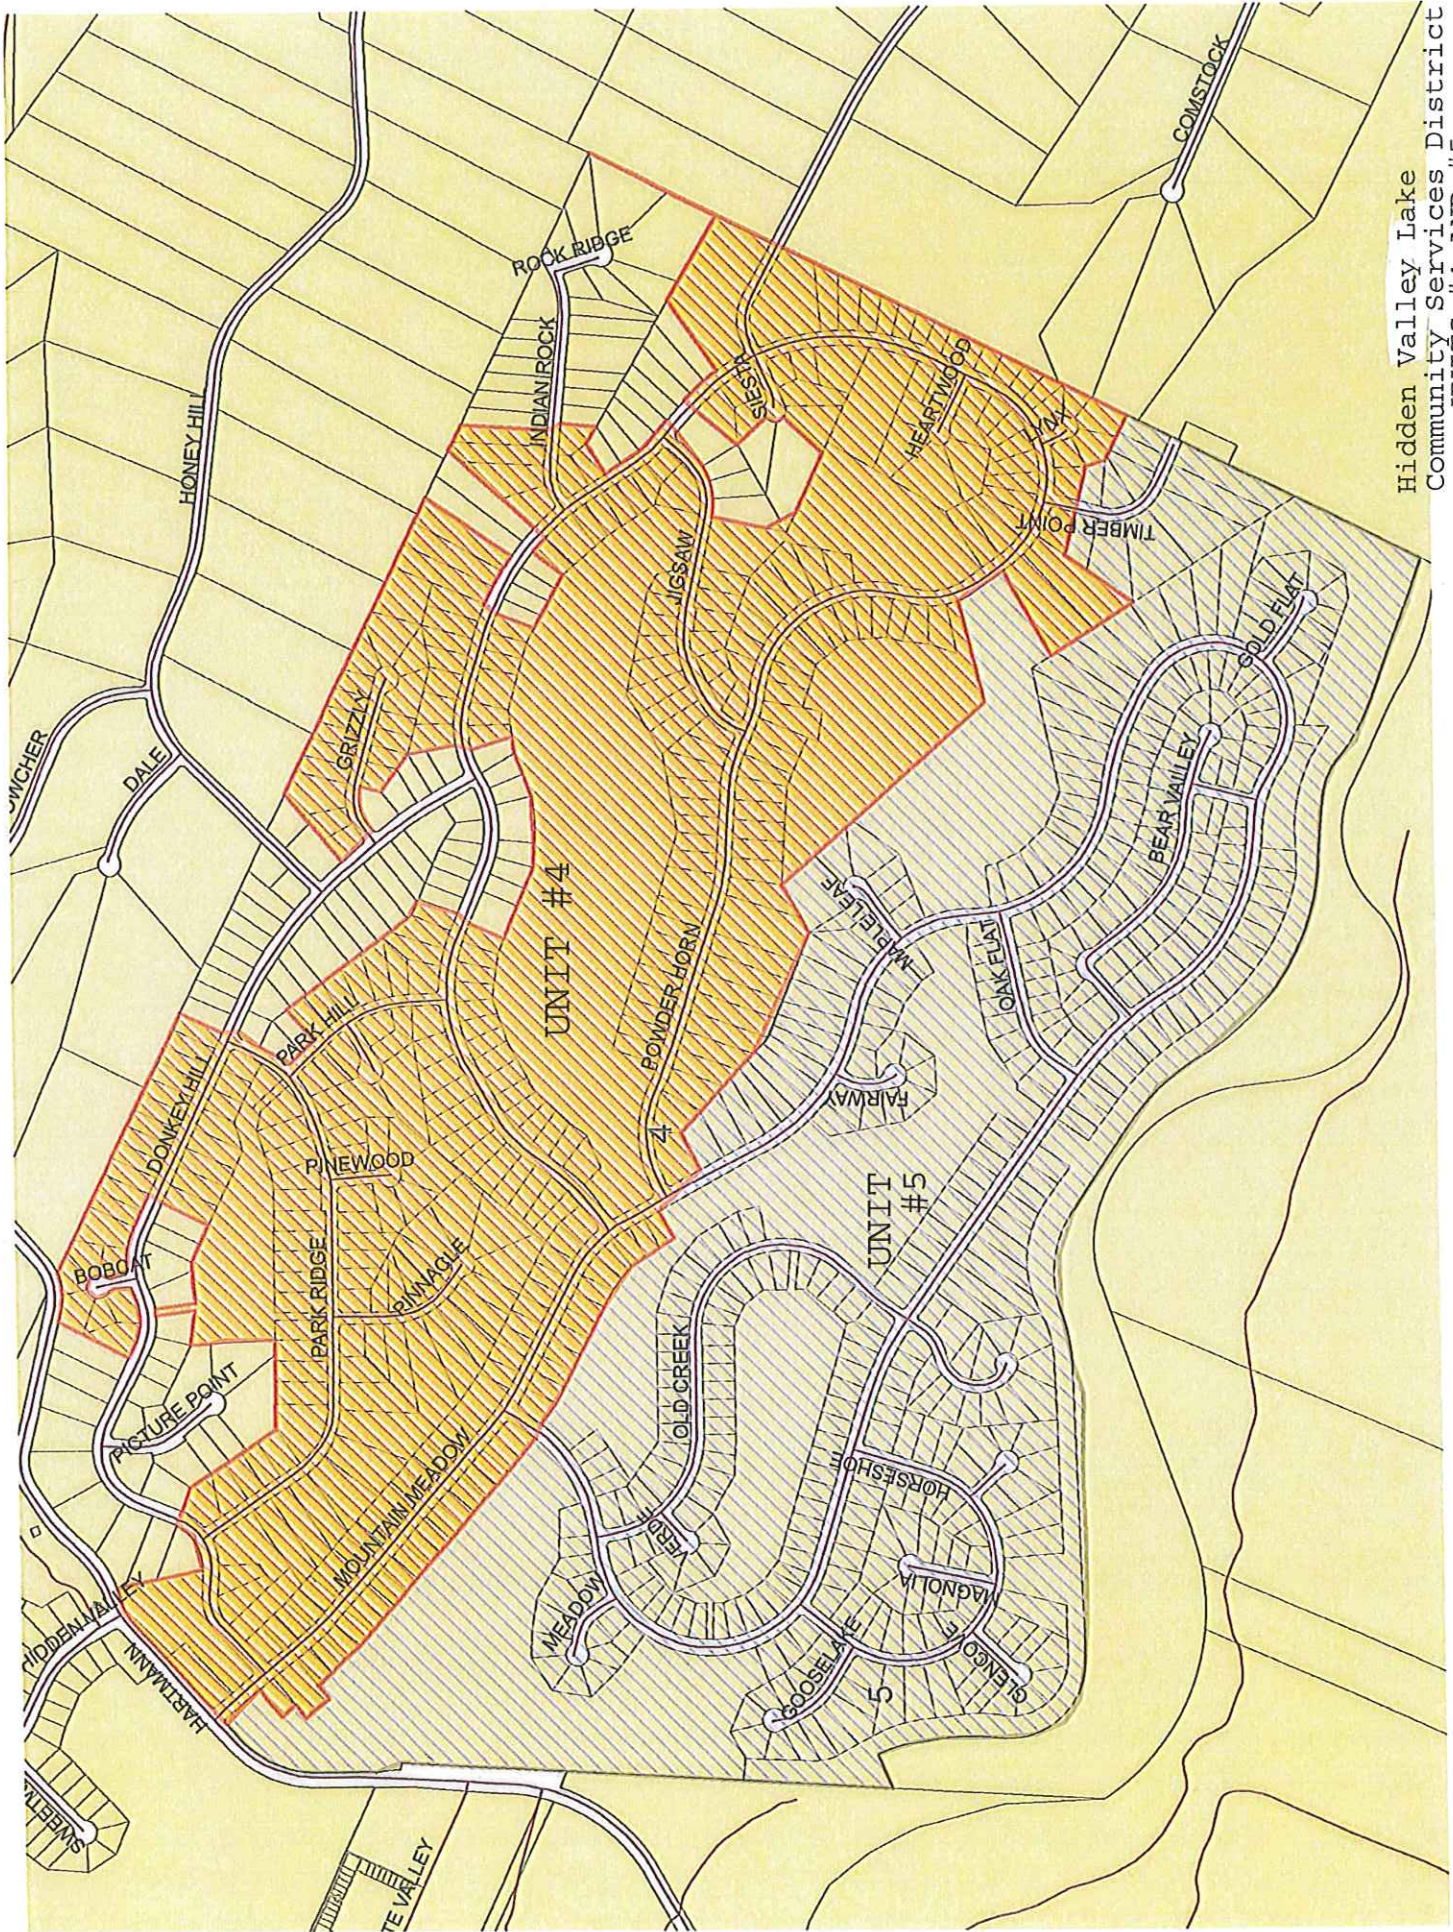

Hidden Valley Lake  
Community Services District  
UNITS #4 AND #5